


#### FEATURES

- ✓ Compatible with FireSense 2800 & 3030 Addressable Fire Panels
- ✓ Compatible with standard and high speed NOTI-FIRE-NET™
- ✓ Monitor four (4) compatible NFN or HS-NFN nodes not including the Modbus Gateway node itself
- ✓ Provide data such as event type, active/inactive, isolate/deisolate, acknowledged/unacknowledged, device type and system faults
- ✓ Support reads of up to 100 registers at a time - analog values can be read 10 registers at a time
- ✓ Receive configuration data from the Modbus Gateway Configuration Tool
- ✓ Log diagnostic information
- ✓ Send standard Modbus exception responses
- ✓ Reduce configuration time by self configuring all nodes and points

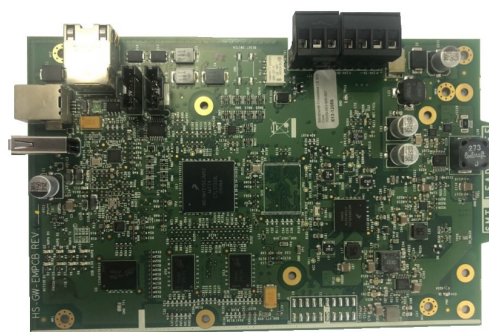

#### PRODUCT DESCRIPTION

The Modbus Gateway provides a communication link between networks that use the Modbus/TCP communication protocol and Fire Alarm Control Panels (FACPs) resident on an NFN network.

The NFN network communicates with the Modbus Gateway through a NOTI-FIRE-NET™ network via the network port on any NCM. The Modbus communication protocol is consistent with Modbus Application Protocol Specification V1.1b.

The Modbus Gateway Configuration Tool, a programming utility included with the Modbus Gateway assembly, is used to configure the Modbus Gateway. The Modbus Gateway is designed to need very little configuration. In most applications you will only need to enter the TCP/IP settings for your network and the nodes you would like to monitor. The gateway will automatically map all the configured points and supply you with a user friendly value report.

Requires a Windows XP based computer to run the Modbus Configuration Tool.

#### TECHNICAL SPECIFICATIONS

The Modbus Gateway was designed to be compatible with standard Modbus/TCP masters. Support one-byte unit IDs. Have configurable polling times. The Modbus Gateway supports one Modbus Master.

Power Supply	24Vdc to 5Vdc
Input Voltage Range	19Vdc to 29Vdc. Input current is 360mA @ 24Vdc
Output Current	1.2A @ 5Vdc
Operating Temperature	0°C to 49°C

#### CONNECTION INFORMATION

An Internet or Intranet IP network connection is required to configure the Modbus Gateway, and to connect it with Modbus clients. The Internet or Intranet IP network connection must meet the following requirements:

- ✓ Private or Business LAN
- ✓ Static IP address required
- ✓ Standard 100Base - T connection
- ✓ Required Ports(s): 502

#### REQUIRED EQUIPMENT

- ✓ MODBUS-GW-NFN to Modbus Embedded Gateway
- ✓ Network Control Module
- ✓ NFN Network - Version 5.0 or above
- ✓ Modbus Configuration Tool

#### NETWORK COMPONENTS

- ✓ RJ45 to RJ45 standard Ethernet network cable customer's internet or intranet connection to Modbus Gateway
- ✓ NFN network version 5.0 or above (sold separately)
- ✓ High Speed Network Communication Module: HS-NCM-W/SF/MF board used to facilitate network communication between the Modbus Gateway and a High Speed NFN Network or Network Communication Module: NCM-W/F board used to facilitate network communication between the Modbus Gateway and an NFN network.

#### SYSTEM ARCHITECTURE EXAMPLE

